

APPLICATION TO INSTALL PRIVATE LINE

DATE: 01/09/2023

TO THE COMMISSIONERS COURT OF BROWN COUNTY,

Application is hereby made by Atmos Energy Corp, to install a buried X or aerial water telephonic electric gas X line within the right-of-way and/or across a county road in Brown County, Texas, as follows:

Precinct # 3 Location: CR 344 West of FM 3100 (This will involve a bore X or cut _____

The location and description of the proposed line and associated appurtenances is more fully shown by the plat of such line attached to this application. The line will be constructed and maintained on the County right-of-way in accordance with governing laws. And installed at a depth of 24" to 30" below the lowest level of the bar ditch.

The applicant agrees to remove or relocate such fixtures at his own expense so as to permit the widening or changing of traffic lanes or reconstruction of the roadbed. Such removal or relocation shall be within 30 days of written notice specifying the fixtures to be moved and indicate the place on the roadway to which they shall be replaced.

Notwithstanding any other provision contained herein, it is expressly understood that tender of this notice by the undersigned does constitute a waiver, surrender, abandonment or impairment of any property rights, franchise, easement, license, authority, permission, privilege or right now granted by law or may be granted in the future and any provision of provisions so construed shall be null and void.

The Commissioner of the above precinct will be notified of the time and date of installation at least 24 hours in advance

This permit will become null and void if work is not completed within 90 days from date of acceptance by the Brown County Commissioners Court.

I certify that the above-proposed installation will not impair or harm the ingress and egress of adjacent landowners.

Construction of this line will begin on or after the 6th day of February, 2023

By Debbie Hudson
Address 4304 Danhil Drive
Brownwood TX 76801
Phone 3256424105

January 17, 2023
(Exhibit #9)

31.816013, -98.903833

Legend

- Main Existing High Pressure Route
- Main Existing Intermediate Pressure Route
- Main Unknown Under Pressure Route
- Abc: Def: Main Annotation Existing Annotation
- Abc: Def: Coupling Existing Location - No
- Abc: Def: Coupling Station Plus Annotation - Existing
- Abc: Def: Reducer Existing Location
- Abc: Def: Reducer Station Plus Annotation - Existing
- Abc: Def: Transition Fitting Existing Location
- Abc: Def: Transition Fitting Station Plus Annotation - Existing
- Abc: Def: Leak Abandoned Location - 3
- Abc: Def: Leak Resolved Location - 3
- Abc: Def: Regulator Station Existing Location - Regulator Station
- Abc: Def: Regulator Station Station Plus Annotation
- Abc: Def: Foreign Pipe Existing Route
- Abc: Def: Custom Drafting Text Remarks Annotation

Install approximately 1600 feet of 2 inch IP HDPE and abandon 1600' of 1" steel main

Install 2" SDR11 HDPE 40 psi MAOP Abandon main

2" PE, 40 psi MAOP
080.28636

31.816009,
-98.902251


Tie in to 2" PE with
a 2" EFC

Install 2" HDPE valve

Tie on to existing
DRS with a 2" Riser

Install 2" HDPE valve

31.815985,
-98.907265

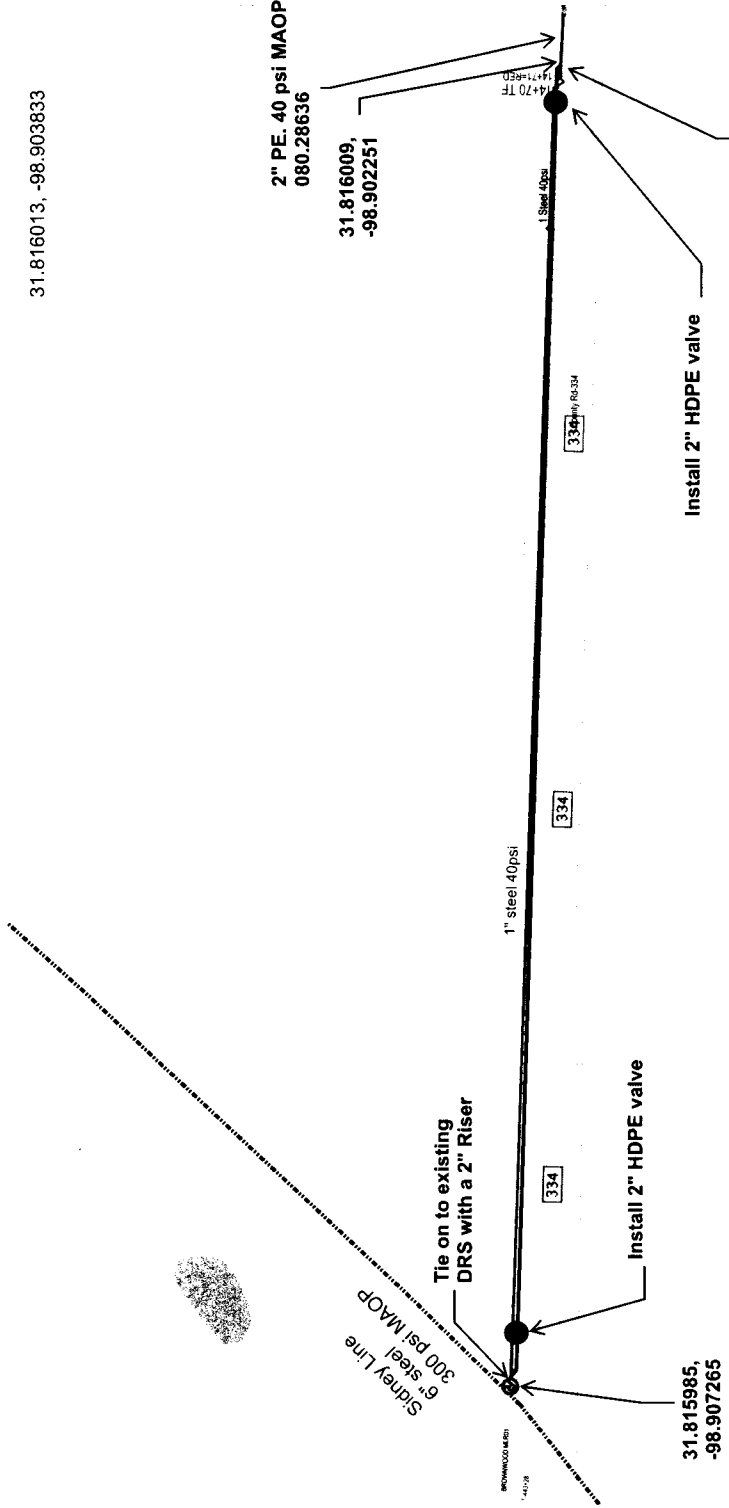

GAS CONSTRUCTION PRINT

PROJECT NO. 080.



SHEET 1 OF 1

PROJECT MANAGER Debbie Hudson

DATE 08/22/2022

100

PHONE 3256424105

MAP #

© 2009 Atmos Energy

Map, drawings and electronic data (products) are created for the internal purposes of Atmos Energy with no intention of suitability or fitness for the external use of the recipient. Atmos Energy does not warrant the accuracy or quality of such products. The locations shown are approximate and are not intended to be used for legal purposes. The recipient agrees not to replicate or distribute the products or information contained herein without the prior written permission of Atmos Energy. Atmos Energy, its subsidiaries, agents, employees and contractors shall not be liable for any damages, expenses and damages resulting from or precluded upon strict liability for personal injury, death or property damage, on account of any defects in the property provided hereunder.

Issued for construction
01/01/2023

Debbie Hudson

Sr. Project Specialist

PROJECT NAME CR 344 west of FM 3100

CUSTOMER

ADDRESS

LOCATION

Early TX



APPROVAL:

Atmas Energy Corp
4304 Danhil Drive
Brownwood TX 76801

The Commissioner's Court of Brown County offers no objections to the location on the right-of-way and/or crossing of your proposed buried line as shown by accompanying drawings and notice dated 01-09-2023, except as noted below:

It is further intended that the Commissioner's Court may require the owner to relocate This line, subject to provisions of governing laws, by giving thirty (30) days written notice.

The installation shall not damage any part of the county road and adequate provisions must be made to cause a minimum inconvenience to traffic and adjacent property owners.

Please notify Wayne Shaw, Commissioner of Precinct # 3,
Twenty-four (24) hours prior to starting construction of the line, in order that we may have a representative present.

BROWN COUNTY COMMISSIONERS COURT
OF BROWNWOOD, TEXAS

BY: _____

County Judge Shane Britton

Exceptions and/or special requirements:

SUBJECT TO BROWN COUNTY SPECIFICATIONS For
boring a road.